





# High Efficiency Drift Eliminators

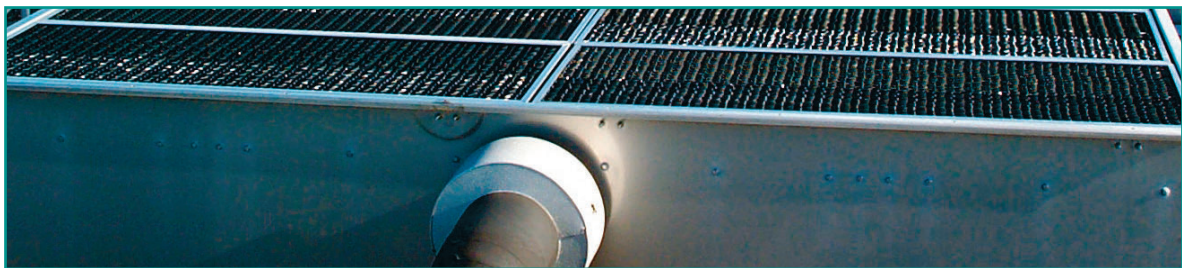

The eliminators offered are of the PVC High Efficiency type which are made from a standard design with modules fabricated to suit the tower support arrangement. The modules are individually encased in 304 stainless steel surround. The surround ensures structural rigidity, prevents the escape of water through the edge of the eliminator form and eliminates the need for hold down ties. Eliminators offered are certified to reduce drift loss to 0.0007% of the circulating rate.

- **Designed & manufactured to fit any make or model cooling tower**
- **Engineered for durability & long life**
- **PVC eliminator media impervious to biological attack, and highly resistant to U.V.**
- **Rigid 304 stainless steel surround**
- **Easy to handle sections for removal for inspection & maintenance**
- **Guaranteed quick delivery**

All Tower Systems replacement parts are guaranteed, where applicable, for thermal performance and equal or exceed the recommendations of The Control of Legionella Bacteria in water systems (L8), the Chartered Institute of Building Services Engineers TM13:2002 and the City of Westminster Guidelines.

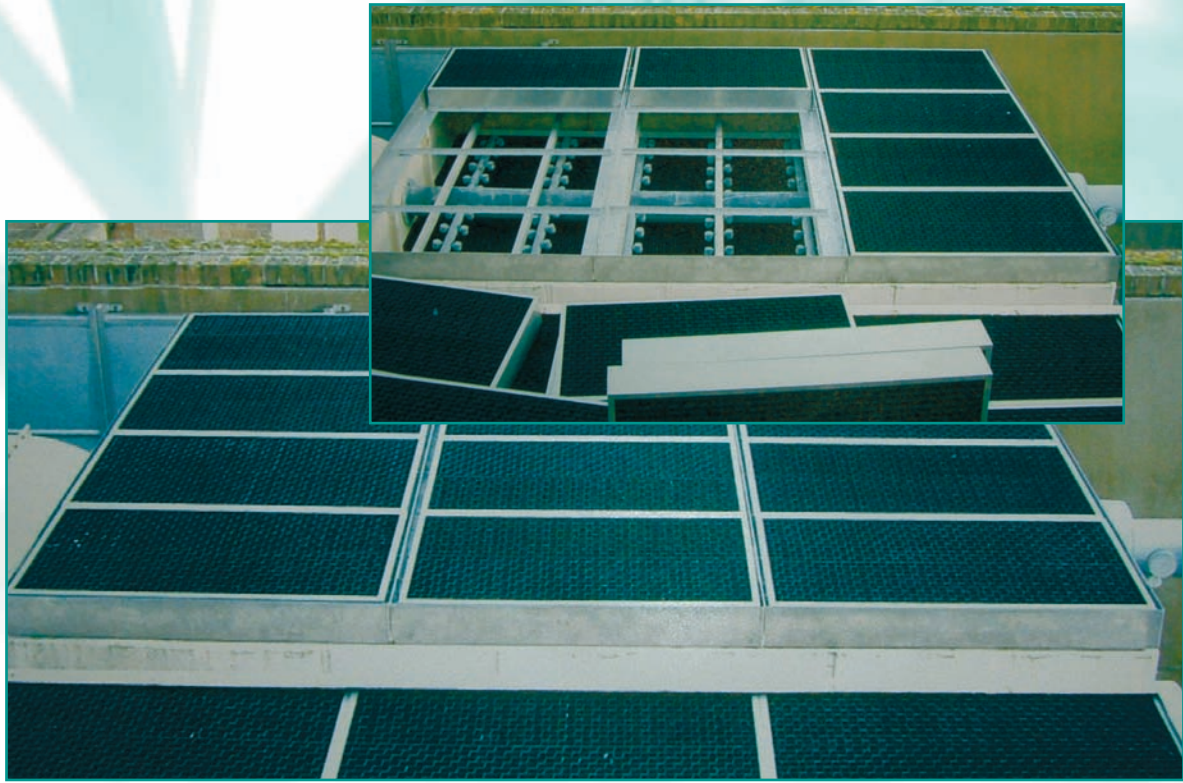

## High Efficiency Drift Eliminators Test Results

Eliminator Type Reference: TS/D-140 (counterflow)

MRI Run No.	Test Cell		Drift Rates				Drift Rates			
	Eliminator No.	Fill Waterflow	(% of water flow rate)			Ratio	(% of water flow rate)			Ratio
	Air Velocity m/s	1/s/m <sup>2</sup>	HBIK	13A	Average	HBIK/13A	HBIK	13A	Average	HBIK/13A
12	1.346	1.386	0.00088	0.00087	0.00088	1.011	0.00152	0.00153	0.00153	0.993
11	2.149	1.386	0.00082	0.00086	0.00084	0.953	0.00092	0.00094	0.00093	0.979
13	2.459	1.382	0.00067	0.00067	0.00067	1.000	0.00064	0.00063	0.00064	1.016
14	2.611	1.386	0.00085	0.00085	0.00085	1.000	0.00077	0.00076	0.00077	1.013
7	2.698	1.389	0.00069	0.00076	0.00073	0.908	0.00062	0.00068	0.00065	0.912
10	2.921	1.382	0.00075	0.00072	0.00074	1.042	0.00059	0.00060	0.00060	0.983
8	3.566	1.382	0.00068	0.00068	0.00068	1.000	0.00044	0.00046	0.00045	0.957
Averages			0.00076	0.00077	0.00077	0.988	0.00079	0.00080	0.00080	0.979



Tower Systems Ltd • Unit 4B Sandown Road • Watford • Herts WD24 7UB  
 Tel: 01923 238603 • Fax: 01923 239093 • E-mail: info@towersystems.co.uk



[www.towersystems.co.uk](http://www.towersystems.co.uk)

Manufactured at a mill that has been awarded the ISO 14001 certificate for environmental management. Pulp bleached using an elemental chlorine free (ECF) process.

